


XACARA NC 2HD SHALLOW HOUSING, REMOTE DRIVER

- 1: These instructions may not cover all details or variations. For additional information contact Beta-calco.
- 2: Luminaires must be installed in accordance with national electrical code and local regulation.
- 3: Disconnect the power before installing the fixture or servicing.
- 4: Min 90°C supply conductors.

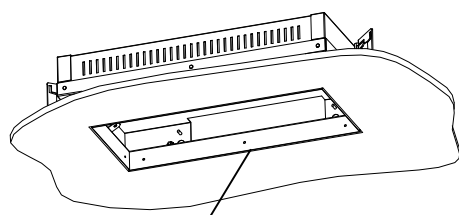

17.4" x 8.2" CEILING CUTOUT

Fig. 1

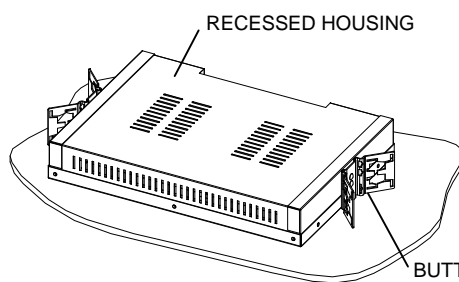


Fig. 2

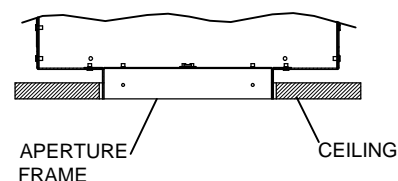


Fig. 3

INSTALLATION STEPS:

1. Create 17.4" x 8.2" cutout in the ceiling (Fig. 1).
2. Remove the trim assembly from the housing assembly by removing two mounting screws (Fig. 6).
3. Place the housing assembly in ceiling opening.
4. Fixture must be supported by structure. Use butterfly brackets to secure the housing assembly to structure. Brackets accept various types of rails (rails are not supplied) (Fig. 2). Before completing installation, be certain that the aperture frame of the housing assembly is flush with ceiling surface or 1/16" above (Fig. 3).
DO NOT allow the aperture frame edge below ceiling surface.
5. Provide electrical service, according to the National Electrical Code or your local electrical code, from a suitable junction box to the gear tray.
6. Remove the gear tray cover by untighten 2 screws (Fig. 4).
7. Connect flexible metal conduit to the gear tray and make all necessary wiring connections (Fig. 4).
8. Re-install the gear tray cover.
9. Push the remote driver box w/ flexible metal conduit through the openings in the recessed housing and secure the gear tray to the recessed housing with two wing nuts (Fig. 5).
10. Ground the trim assembly to the housing assembly (Fig. 6).
11. Raise the trim assembly and secure it to the recessed housing with two screws (Fig. 6).
12. Push in LED plugs into connectors in the gear tray (Fig. 6).

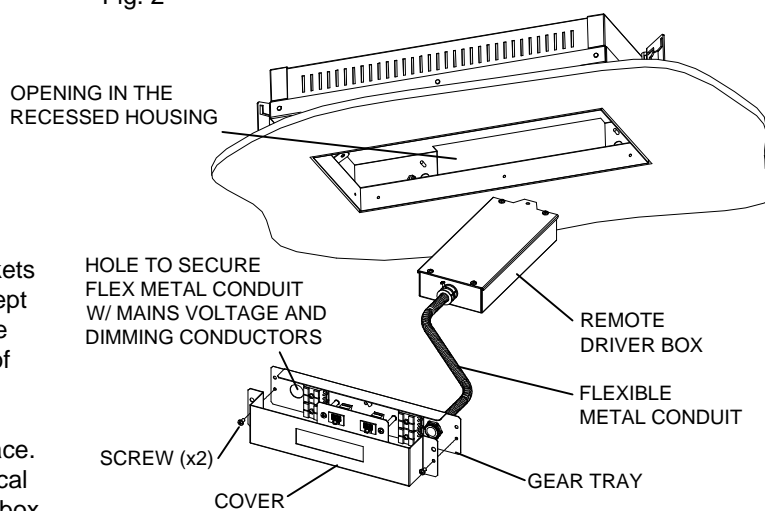


Fig. 4

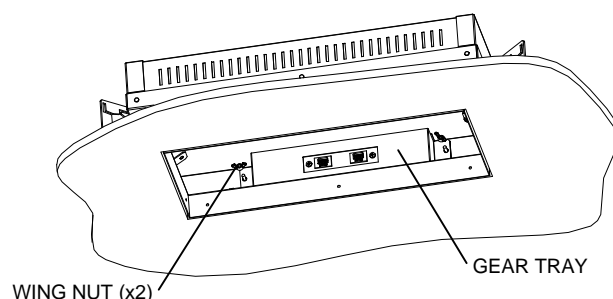


Fig. 5

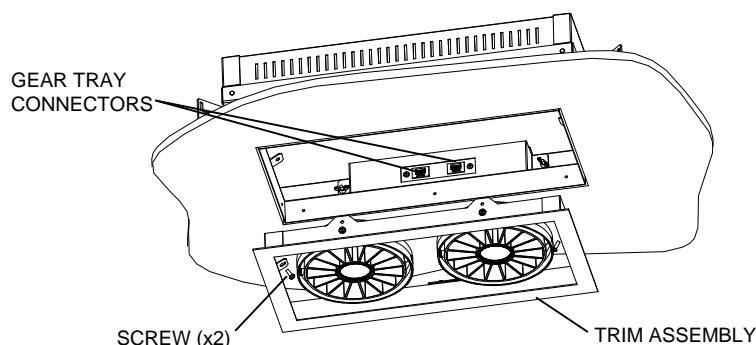


Fig. 6

FIXTURE DESCRIPTION:
XACARA NC 2HD RECESSED

BETA-CALCO INC. 25 Kodiak Crescent, TORONTO ONTARIO CANADA M3J 3E5

 **betacalco**