

# STARBURST RD

FIXTURE NAME: STARBURST RD  
FIXTURE CODE: STRR1P01-STRR2P01  
TYPE: PENDANT  
PAGE 1 OF 1

FIXTURE COMES PARTIALLY ASSEMBLED.



Ensure electrical circuit is disconnected before installation.



Luminaires must be installed in accordance with national electrical code and local regulation.

\*\*\*WARNING\*\*\*

BE CAUTIOUS WHEN HANDLING FIXTURE  
AS FINGERS CAN GET CLAMPED  
BETWEEN MOVING LINKS

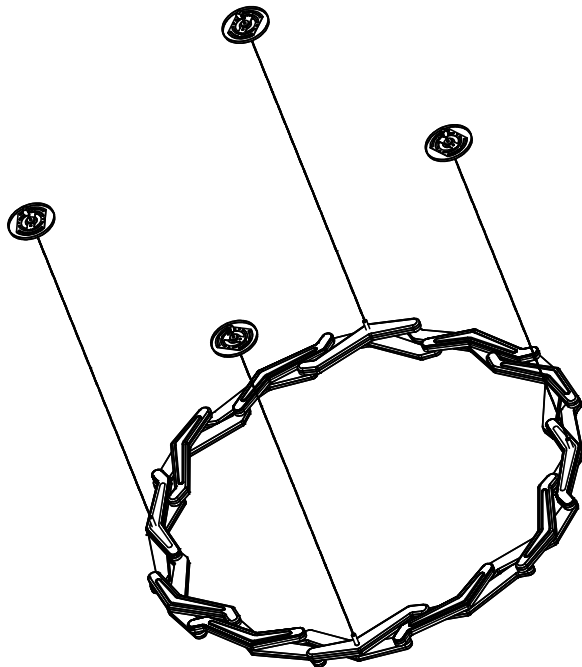


Fig. 1

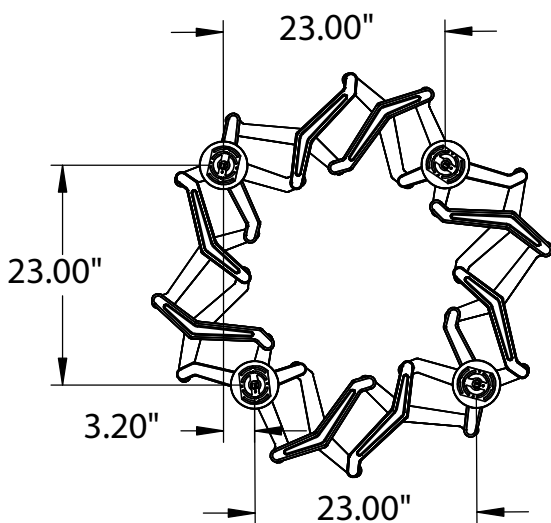


Fig. 2

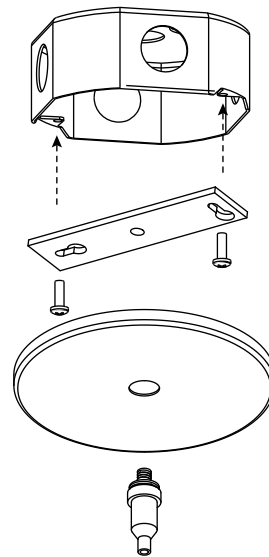


Fig. 3

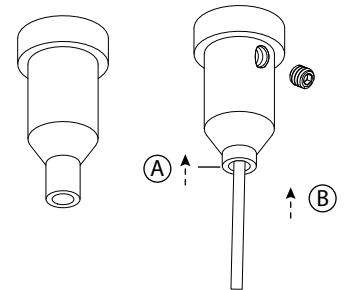


Fig. 4

Maximum remote mounting  
distance from canopy to drivers:

18 AWG = 9.5' (3m)

16 AWG = 19.5' (6m)

14 AWG = 29.5' (9m)

1. Refer to Fig. 2 for locations of power drops.
2. Make appropriate wiring connections and mount the canopies and couplers to the ceiling using appropriate fasteners (not included) according to the structure of the ceiling.
3. Level the fixture using the gliders on the ceiling canopy (Fig. 3). To release the grip lock, press down the top of the mechanism.
4. Lock the position with the set screw after adjustments (Fig. 4).
5. If only direct lighting is required, two of the four power-over aircraft cables will be solely used for suspension purposes and will require no wiring connections (refer to the wiring diagram).