


Ensure electrical circuit is disconnected before installation.




Luminaires must be installed in accordance with national electrical code and local regulation.

Bottom View – No Cover

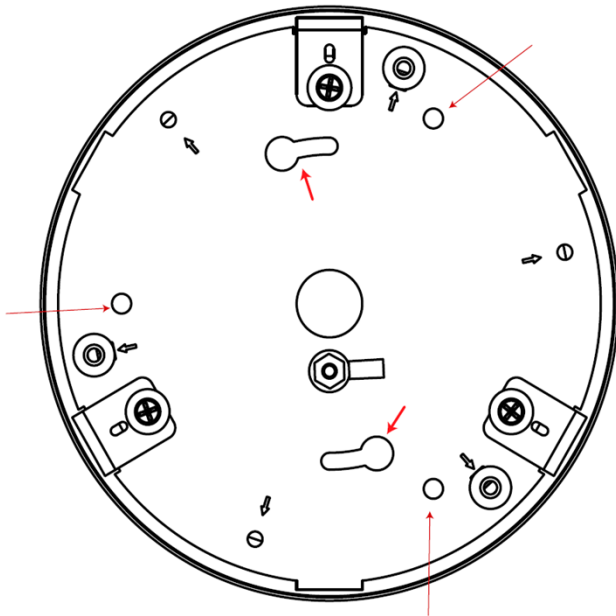


Fasten canopy on to J-box using holes shown above by short arrows and to ceiling with holes shown by long arrows


Top View

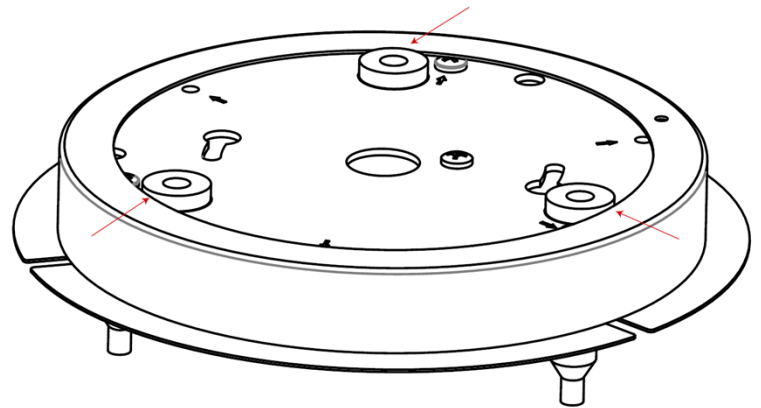


Top view of canopy with arrows pointing to ceiling mounting holes

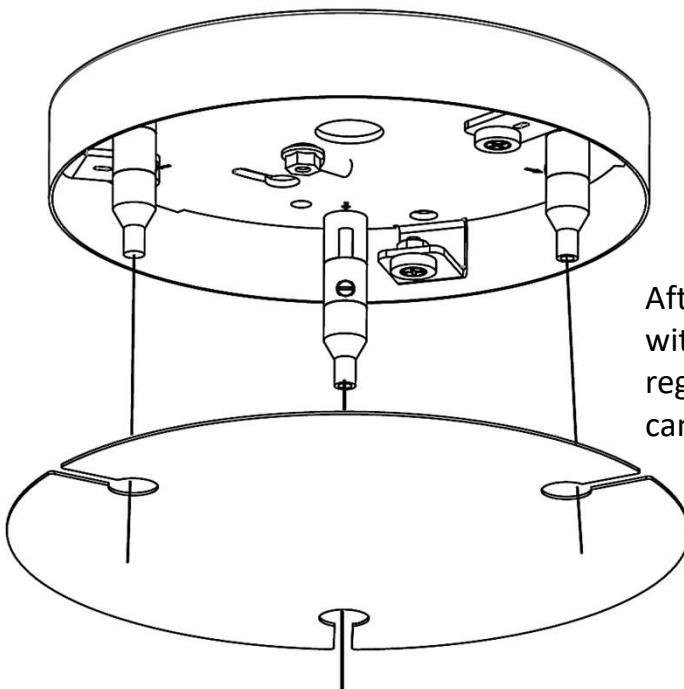


After all connections are done in accordance with national and local electrical codes and regulations, install cover plate on to the canopy.

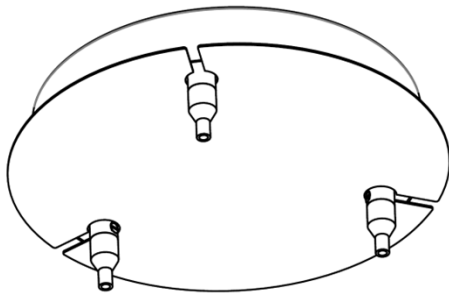

Installed Canopy

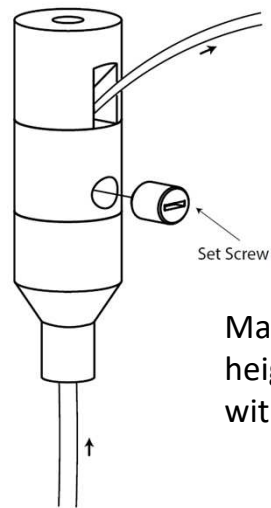


Make fine adjustments to fixture height with glider. Lock position with set screw after adjustment.

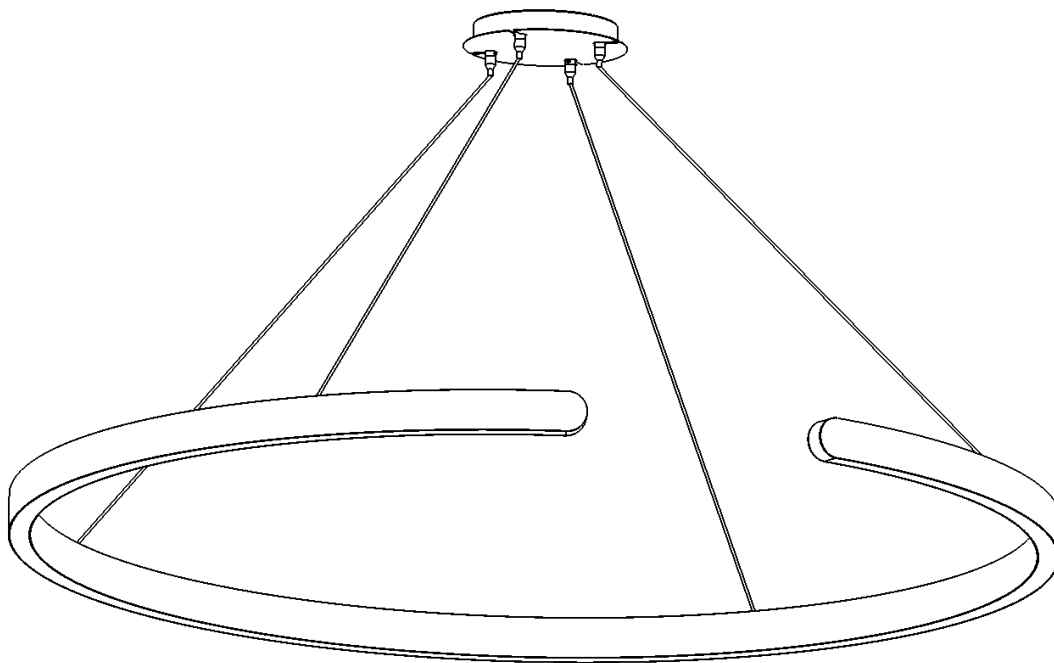


Installed Fixture

Bottom View – No Cover

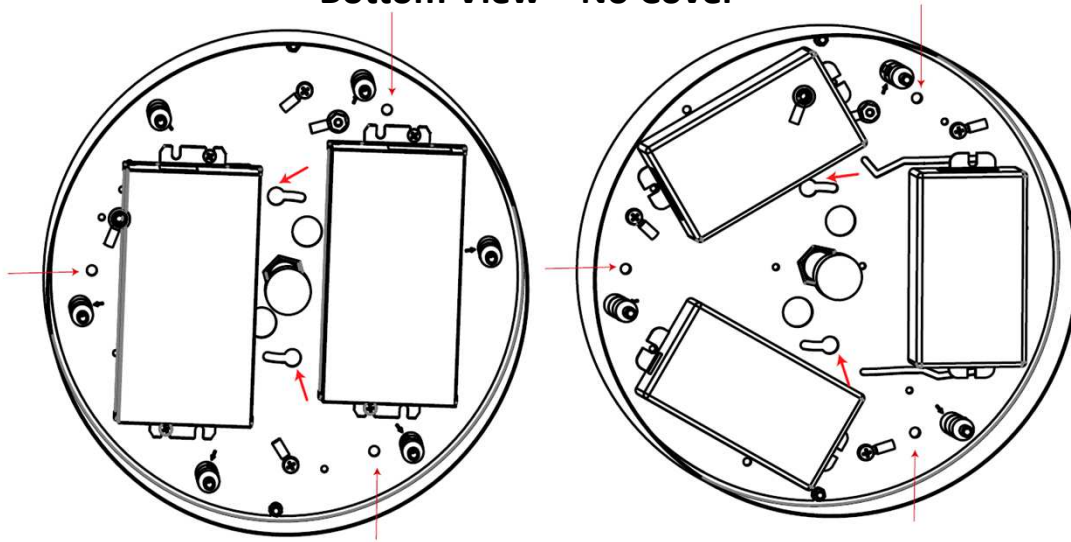


Fasten canopy on to J-box using holes shown above by short arrows and to ceiling with holes shown by long arrows

Top View

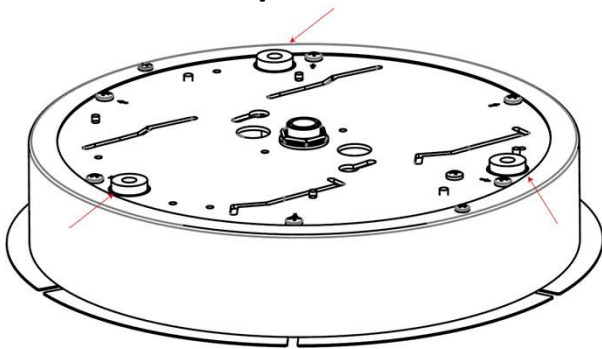


Top view of canopy with arrows pointing to ceiling mounting holes

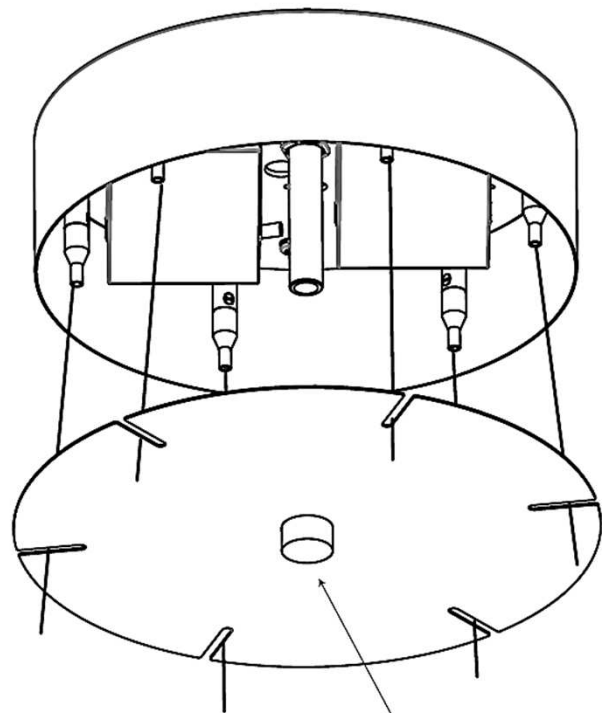


Finial


After all connections are done in accordance with national and local electrical codes and regulations, install cover plate on to the canopy and fasten the finial.

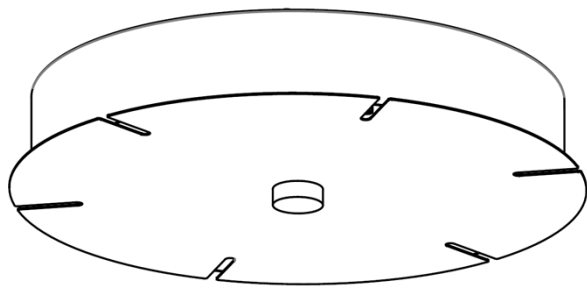

Installed Canopy

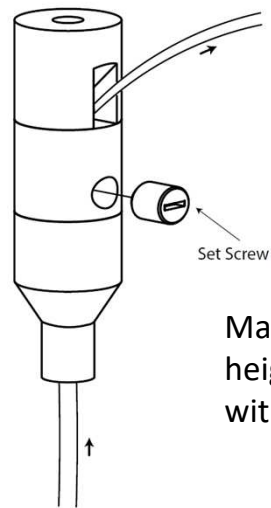

Make fine adjustments to fixture height with glider. Lock position with set screw after adjustment.

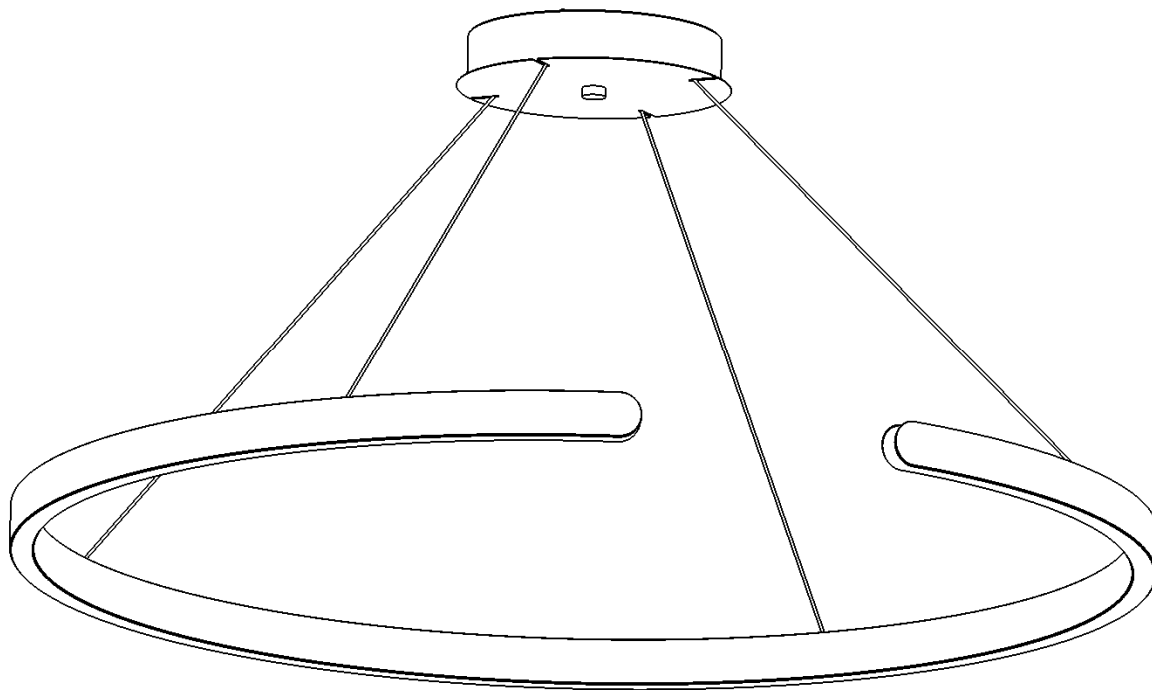

Installed Fixture




PLEASE ENSURE ELECTRICAL CIRCUIT IS DISCONNECTED BEFORE INSTALLATION



NEVER TOUCH THE YELLOW PORTION OF THE LED CHIP OR DAMAGE MAY OCCUR


1. Remove the screws and the drivers' box cover
2. Remove the necessary knockouts
3. Attach the conduits "NOT SUPPLIED"
4. Make the wiring connections
5. Re-attach the cover and secure it with the supplied screws

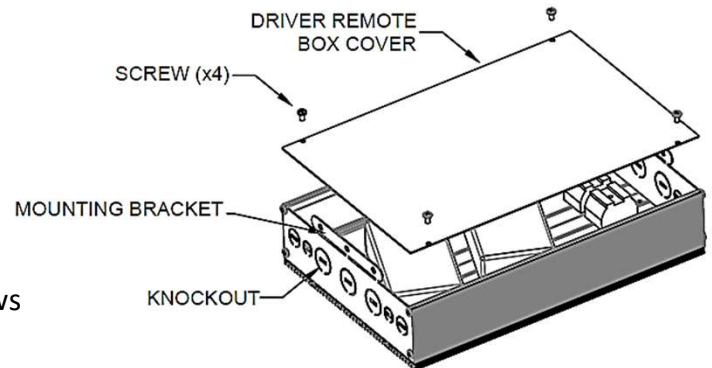


NOTE:

Use the mounting brackets to secure the box in place to the structure of the ceiling (MOUNTING SCREWS BY OTHERS)

SINGLE REMOTE BOX

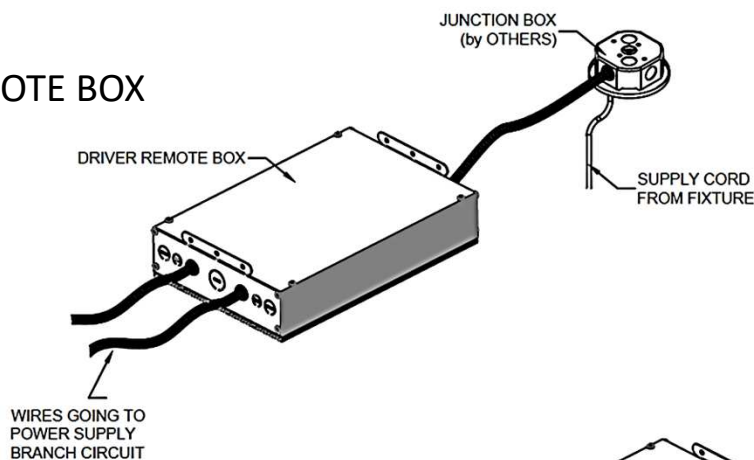

MULTIPLE REMOTE BOX

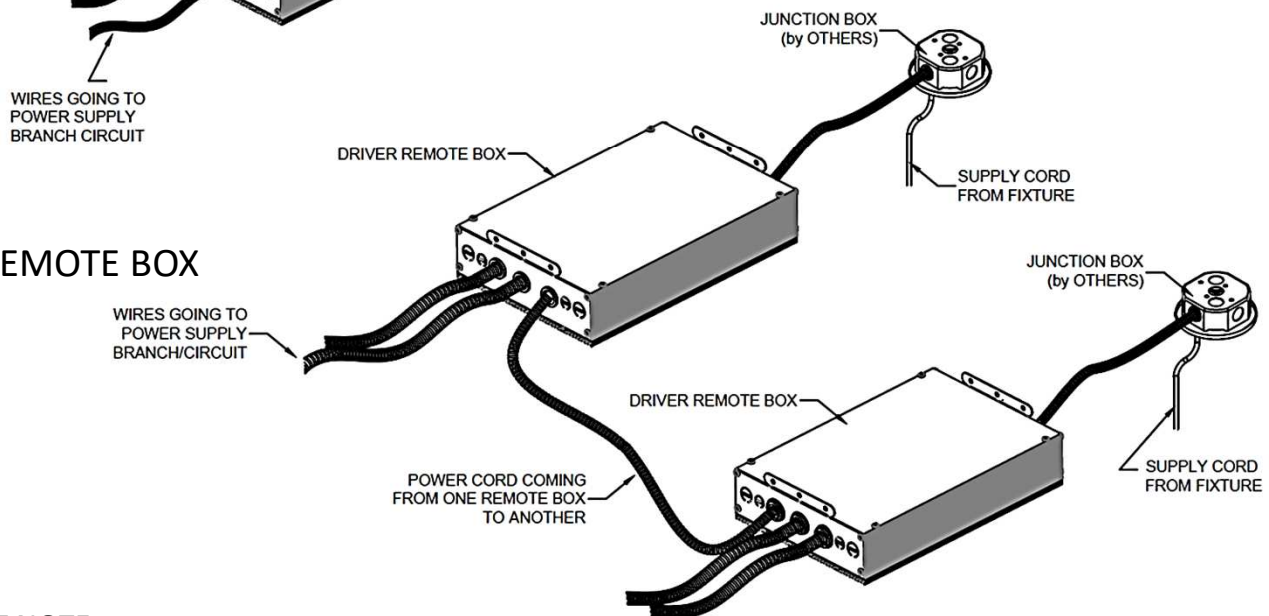

IMPORTANT NOTE:

1. When more than one remote box is supplied, they all must be connected to the same power supply branch circuit
2. Remote boxes should be accessible after installation