

BLOCK™ (OLD) - CONTINUOUS



Project Name:	Fixture Type:
Fixture Code:	Quantities:

A. LUMINAIRE

BLFP1P Direct **BLFP2P** Direct/Indirect

One power cord for every 50 linear ft.

B. LENGTH OF RUN

SFA _ _ _ _

Minimum length to order is 4ft and orders to be in 2ft increments.

Example: 4ft = SFA0400

Example: 10ft = SFA1000

Example: 50ft = SFA5000

For runs over 50ft in length, consult factory.

C. MAX LENGTH PER SECTION

SL04 4ft	SL06 6ft	SL08 8ft	SL10 10ft
SL12 12ft			

You can select the preferred maximum length per segment, to account for transportation and building constraints. Example: If a 40ft run is required and SL12 (12ft) is selected, we would provide 4 10ft segments. For special requirements, please contact sales@betacalco.com.

D. LM/FT (DIRECT)

LPF020 200 lm/ft	LPF040 400 lm/ft	LPF060 600 lm/ft	LPF080 800 lm/ft
LPF100 1000 lm/ft	LPF120 1200 lm/ft	LPF140 1400 lm/ft	

E. LM/FT (INDIRECT)

LPG000 Not required	LPG020 200 lm/ft	LPG040 400 lm/ft	LPG060 600 lm/ft
LPG080 800 lm/ft	LPG100 1000 lm/ft	LPG120 1200 lm/ft	LPG140 1400 lm/ft ¹
LPG165 1650 lm/ft ¹			

¹ Available with UD1 (clear diffuser) only.

F. CRI

CR80 CRI 80+ **CR90** CRI 90+

G. CCT DIRECT

CTA30 3000K **CTA35** 3500K **CTA40** 4000K

H. CCT INDIRECT

CTB00 Not required **CTB30** 3000K **CTB35** 3500K **CTB40** 4000K

I. DIRECT DIFFUSER

DD1 Asymmetric ¹ **DD2** Batwing Diffuser **DD3** Diffused

¹ When standing at the end view of the profile on the side where the power cord is installed, the asymmetric beam will aim to the right.

BLOCK™ (OLD) - CONTINUOUS

J. UPLIGHT DIFFUSER

UD0 Not required	UD1 Batwing	UD3 Asymmetric ¹
-------------------------	--------------------	------------------------------------

¹ Available up to 1200 lm/ft.

K. UPLIGHT BLACKOUT PLATE

UB00 Not required	UB_ _ Blackout plate ¹
--------------------------	--

¹ Available on a per foot basis. May be required to prevent lighting up of duct work in loft type applications.

L. VOLTAGE

V1 120/277V	V2 240V ¹	V3 347V ²	V4 Low Voltage ³
--------------------	-----------------------------	-----------------------------	------------------------------------

¹ Not available in North America.
² Only available with DA01 dimming.
³ Only available with DA45 dimming.

M. DIMMING

DA01 0-10V Dimming 1.0% DA30 DSL/switchDim ²	DA02 0-10V Dimming 0.1% ¹ DA45 PoE ³	DA20 DALI Dimming 0.1% ¹	DA21 DALI Dimming 1.0% ¹
--	---	--	--

¹ Not available with V3.
² Not available in North America.
³ Only available with V4.

N. CEILING TYPE

G1 Grid ceiling ¹	H1 Hard ceiling ²
-------------------------------------	-------------------------------------

The cost for the canopies, power cables, connections mechanisms and endcaps for the fixture has been added to these items.
¹ Combo kit provided includes installation to T-bar and through tile mount.
² Designed for drywall ceilings.

O. SUSPENSION

HLA03 3ft cable suspension	HLA06 6ft cable suspension	HLA09 9ft cable suspension
-----------------------------------	-----------------------------------	-----------------------------------

* Note: Special order available on lengths over 13ft and may be subject to longer lead times, consult factory.

P. FIXTURE FINISH

FA01 White - Textured FA27 Wood grain - Light Cherry ¹ FA46 Charcoal Metallic - Textured	FA02 Black Metallic - Textured FA28 Wood grain - Dark Walnut ¹ FA47 Bronze Metallic - Textured	FA20 Silver Metallic - Textured FA44 Midnight Blue Metallic - Textured FA52 Champagne Metallic	FA25 Gold Metallic - Textured FA45 Copper Metallic FA53 Red Metallic - Textured
--	--	---	--

¹ Longer than normal lead times may apply, consult factory.

Q. CANOPY FINISH

CF01 White - Textured CF44 Midnight Blue Metallic - Textured CF52 Champagne Metallic	CF02 Black Metallic - Textured CF45 Copper Metallic CF53 Red Metallic - Textured	CF20 Silver Metallic - Textured CF46 Charcoal Metallic - Textured	CF25 Gold Metallic - Textured CF47 Bronze Metallic - Textured
---	---	--	--

BLOCK™ (OLD) - CONTINUOUS

R. QUANTITY OF EMERGENCY SECTIONS

E0 Not required	E1 Emergency system - Integral ¹	E3 Emergency generated circuit - Remote ¹
------------------------	--	---

¹ Specify quantity of emergency sections or emergency generator circuits required based off total length of run. ¹ Available upon request, consult factory for details. Not available with 347V.
Note: a drawing will be required at time of ordering to determine the required location of the emergency sections or generator circuits.


S. CIRCUITS

CS1 Single circuit	CS2 Dual circuit ¹
---------------------------	--------------------------------------

T. SENSORS

BLOCK™ (OLD) - CONTINUOUS

DIMENSIONAL DIAGRAMS

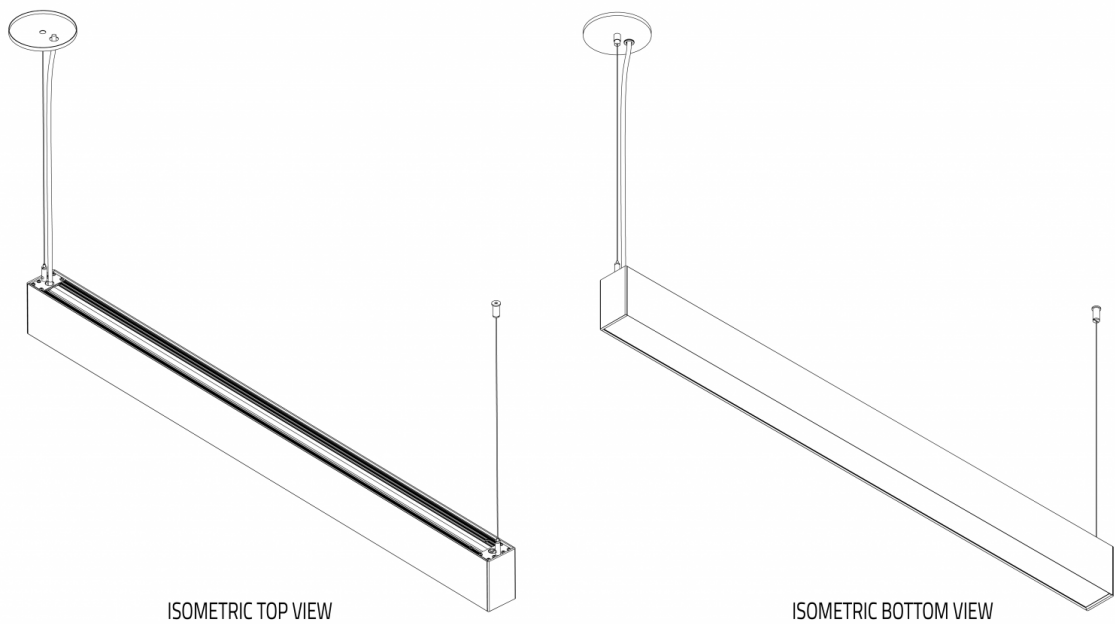

Top View
(Asymmetric Light Direction)

